


REVISIONS			
SYM	DESCRIPTION	DATE	APPROVED

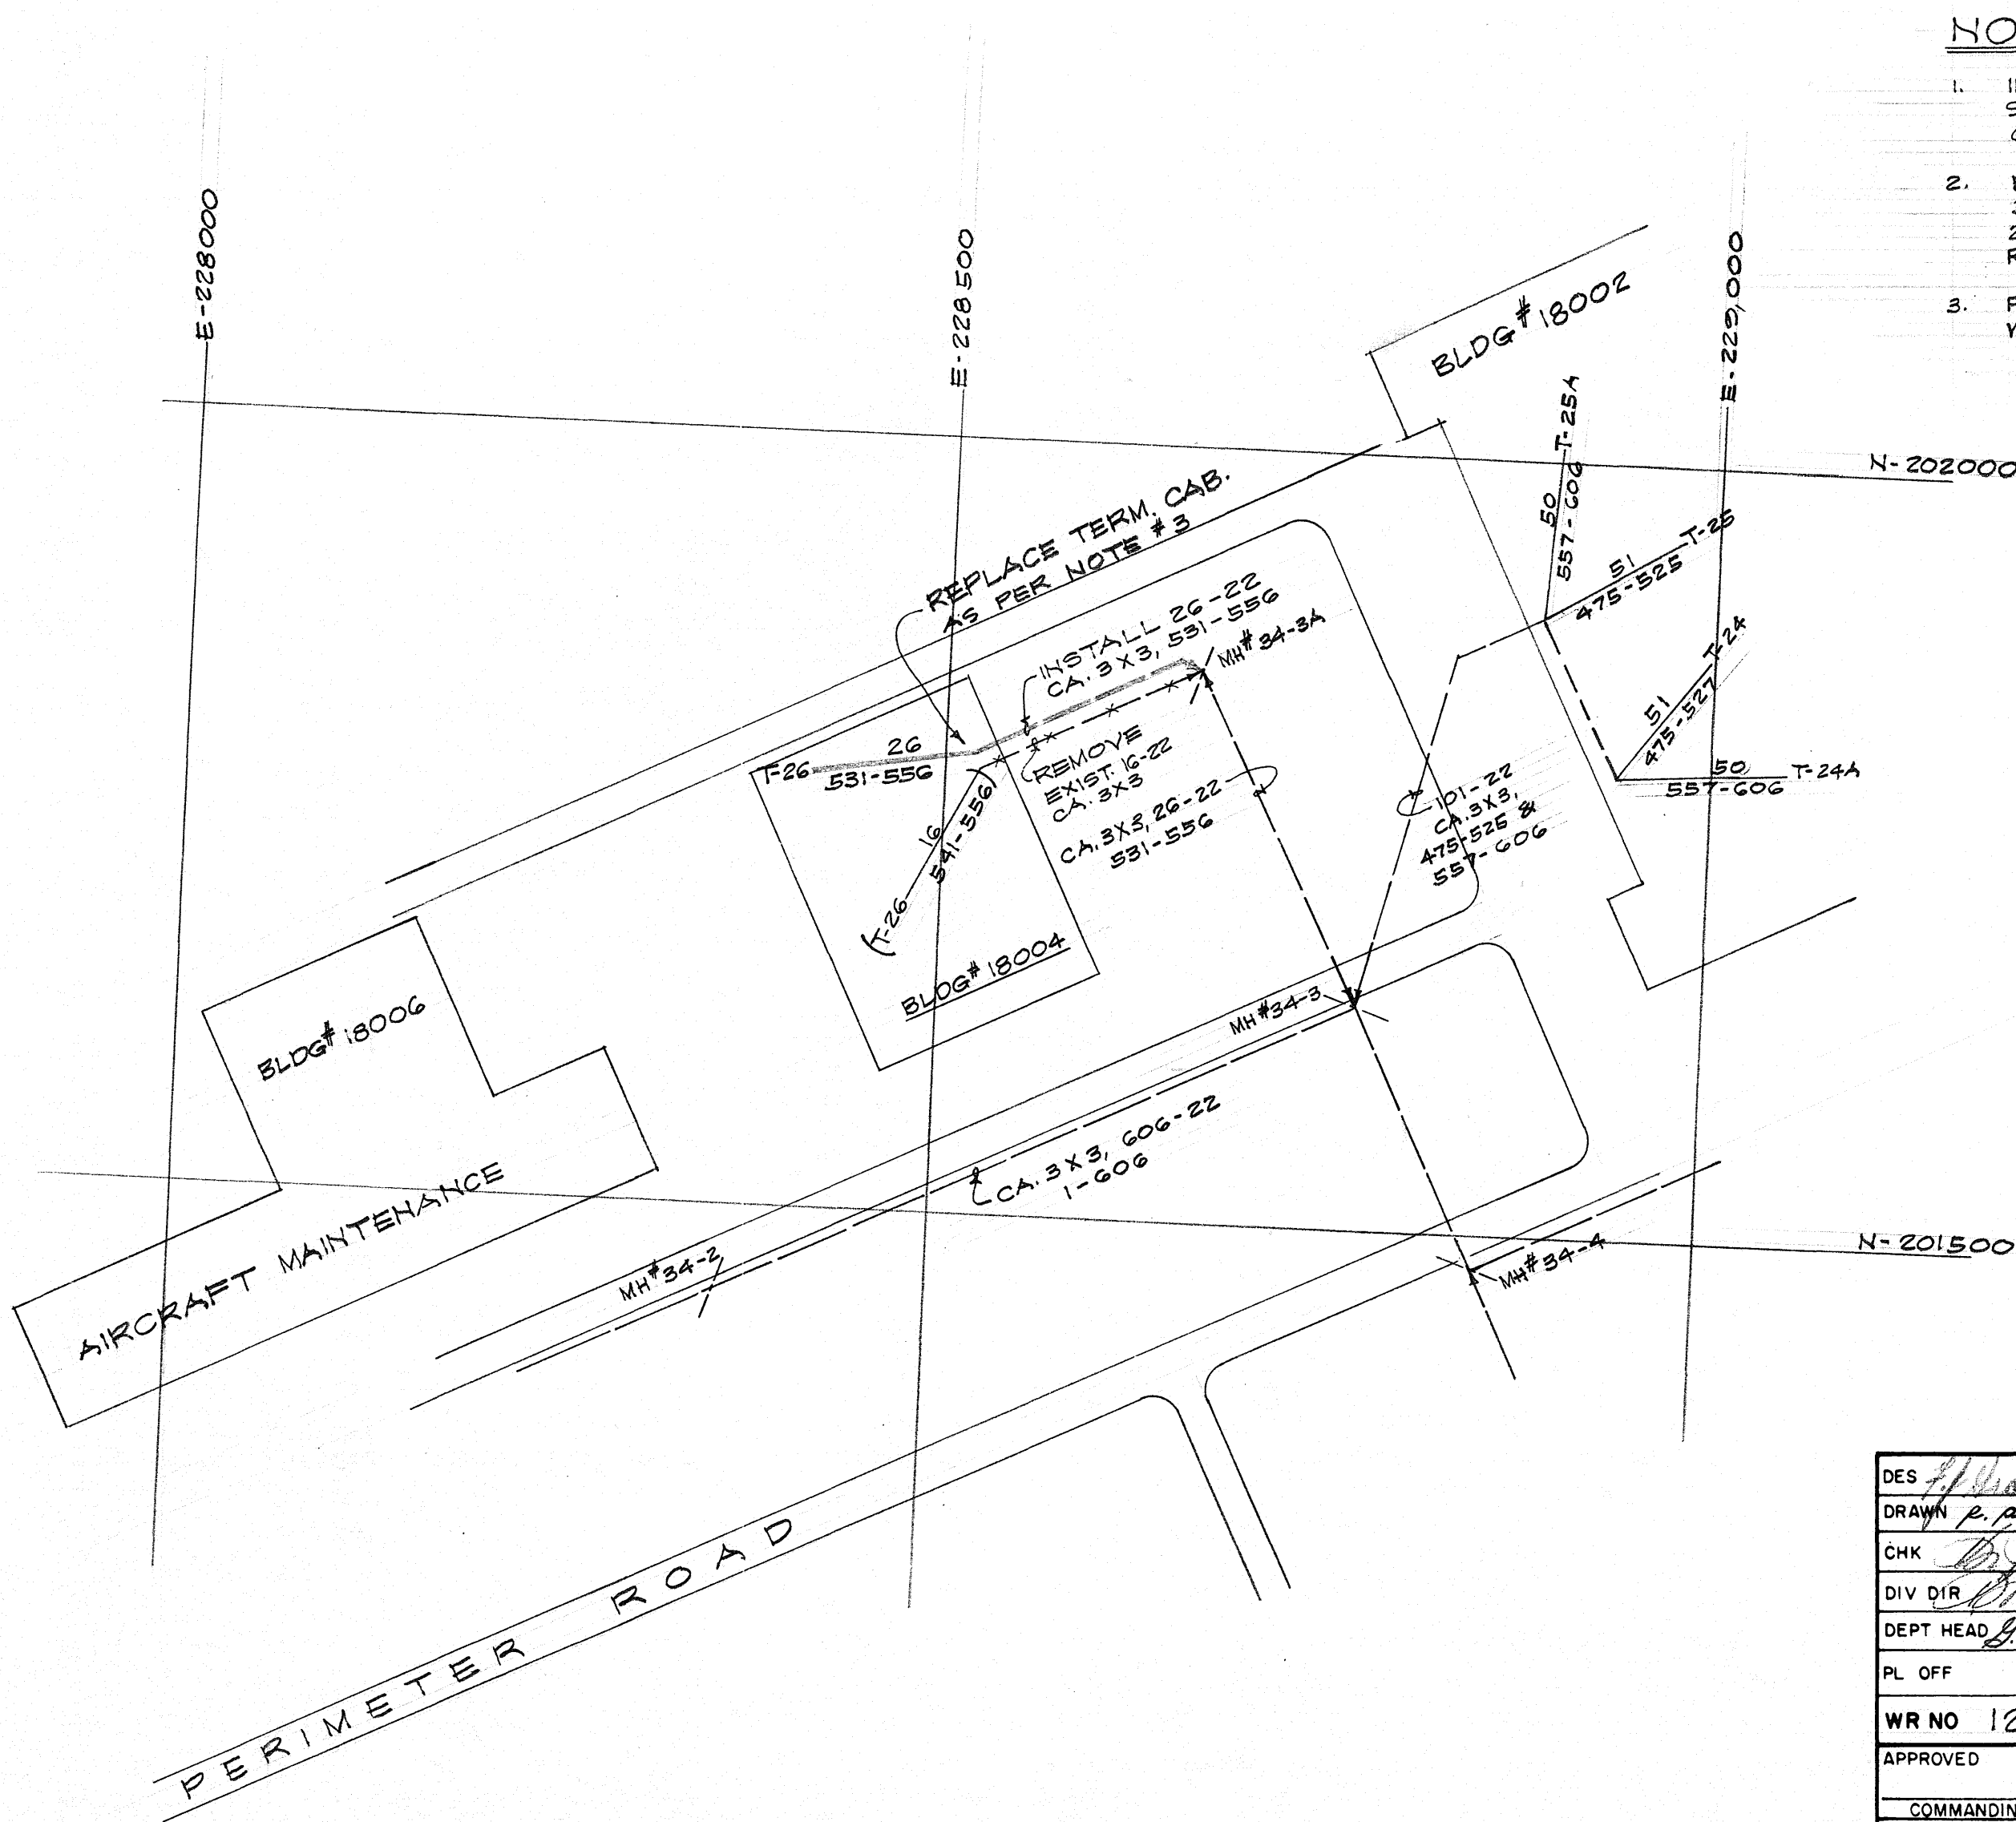

NOTES:

1. INSTALL TEMPORARY 16 PR. CA. FROM MH#34-3A TO BLDG. AND SPLICE IN MULTIPLE WITH EXISTING CABLE. TRANSFER ALL LINES OF EXIST. 16 PR. CA. TO NEW 16 PR. CA. PULL OUT EXIST. 16-22 CABLE.
2. PULL IN 26-22, CA. 3X3, 531-556 IN EXIST. 2" DUCT, SPLICE TO CABLE 3X3, 531-556 IN MH#34-3A AND TERMINATE IN BLDG TO A NEW 26 PR B.B.C. TRANSFER ALL LINES TO NEW 26 PR. CA. AND REMOVE TEMPORARY CABLE.
3. PROCURE OR FABRICATE TERMINAL CABINET 12" W X 24" X 4" D WITH HINGED DOOR

DES <i>J. Handman 6/10/66</i>	DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND		
DRAWN <i>P. P. Dancel 6/66</i>	PUBLIC WORKS CENTER		
CHK <i>[Signature]</i>	GUAM, M. I.		
DIV DIR <i>[Signature]</i>	ANDERSEN AIR FORCE BASE		GUAM, M. I.
DEPT HEAD <i>J. V. Barlow 6/13/66</i>	REPLACEMENT CABLE		
PL OFF	INSTALLATION		
WR NO 1210039	TO BLDG #18004		
APPROVED _____	DATE _____	CODE IDENT NO 80091	SIZE C
COMMANDING OFFICER _____		PWC DRAWING NO 13950	
		SCALE 1" = 100'	SHEET 1 OF 1