


SECTION SHOWING AIR CONDITIONING UNIT

SCALE 1/2" = 1'-0"

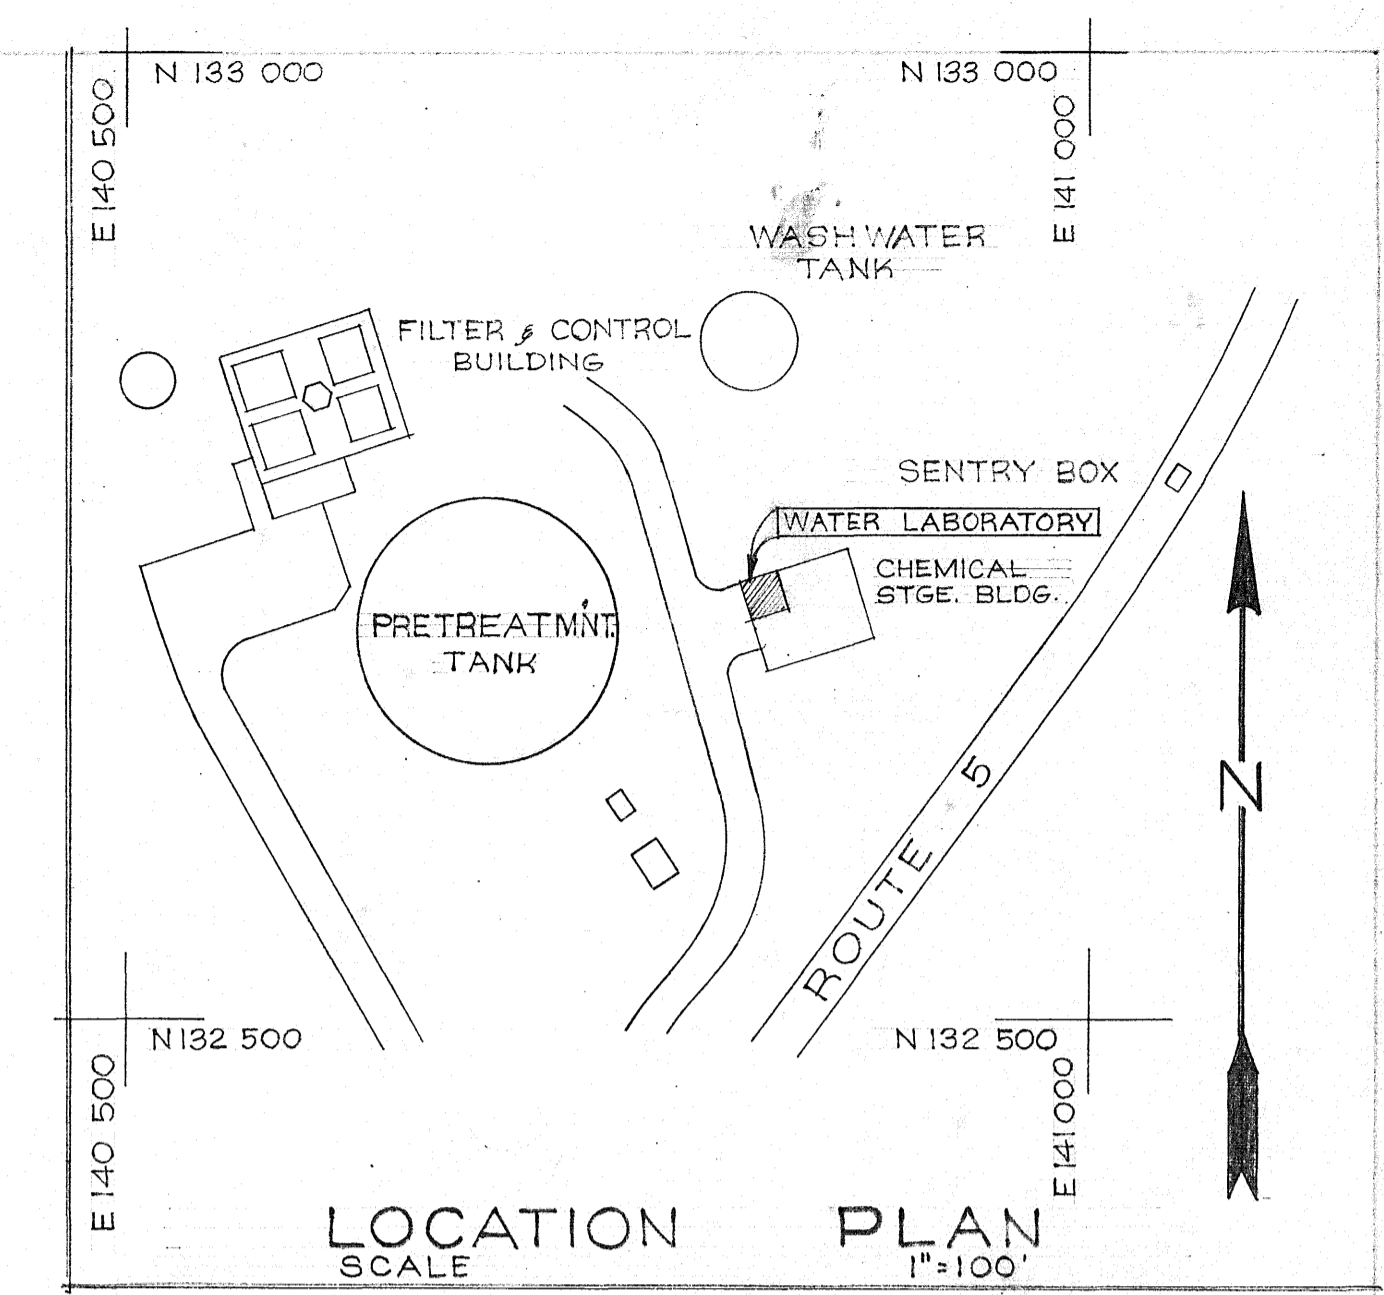

NOTES

- MECHANICAL**
- AIR CONDITIONING UNIT SHALL BE WS 71-179, CARRIER CORP. MODEL SUPPLIED BY EXISTING NAVY SOURCES.
 - DOORWAY INSULATION SHALL BE 1-INCH THICK FIBERBOARD. OPENINGS TO BE SEALED TIGHT AGAINST LEAKAGES.
 - AIR VENT SHALL BE OF Ga.#20 G.I. SHEET METAL, FABRICATED, AND INSTALLED AS SHOWN.
 - DRAIN PIPING SHALL BE 3/4" G.I. PIPE AND FITTINGS.
- ELECTRICAL**
- ALL WORK TO BE DONE IN ACCORDANCE WITH BYD. Spec. 977 AND THE NATIONAL ELECTRICAL CODE.
 - INSTALLATION TO BE IN 3/4" E.M.T.
 - CONTROL CONDUIT TO BE TERMINATED IN NEW JUNCTION BOX, ENCLOSING CONTROL DISCONNECT PLUGS (ABANDON EXISTING CONTROL CORDS). JUNCTION BOX-G17-J-62790-6586.
 - MOUNT 60A. DISCONNECT SWITCH ON SIDE OF UNIT CONTROL PANEL. TAP MAIN BUS FOR SUPPLY.

INDEX		REVISION	DATE	APP'D.	DESCRIPTION	BY
		4/7/55			REMOVED ENCLOSURE FOR A/C UNIT	
P.W.C. DRAWING NO.		9/N26-1/7269				
DRAWN		TRACED				
CHK'D.		APPROVED				
SUPRV.		DES. ENG.				
BR. MGR.		DIV. DIR. MATTHEWS				
73		5/3/53				
73.1		4/2/55				
311		4/2/55				
INSP		10/21/59				
DRG		10/21/59				
PAC-4/MSF		10/21/59				
TO		DATE				
ISSUES		DATE				

U. S. NAVAL BASE MARIANAS GUAM, M. I.	
PUBLIC WORKS CENTER	
FENA WATER TREATMENT PLANT	
CHEM. STORAGE BLDG.- LAB.	
INSTALLATION OF AIR COND. UNIT	
MECHANICAL - ELECTRICAL - STRUCTURAL	
APPROVED: <i>[Signature]</i> 10/4/54	
COMMANDING OFFICER DATE	
P. & E. NO. 5708	
SATISFACTORY TO ACTIVITY	
SIGNATURE	
DATE	
SCALE AS SHOWN	
SHEET NO. 1 OF 1	
YARDS & DOCKS	
DRAWING NO.	

CR 500

9/N26-1/7269